


Drawing name: M:\Engineering Services\Engineering Design Projects\RESOURCE References\WCC Standard Drawings\SD6-3.dwg (27 Mar, 2025)

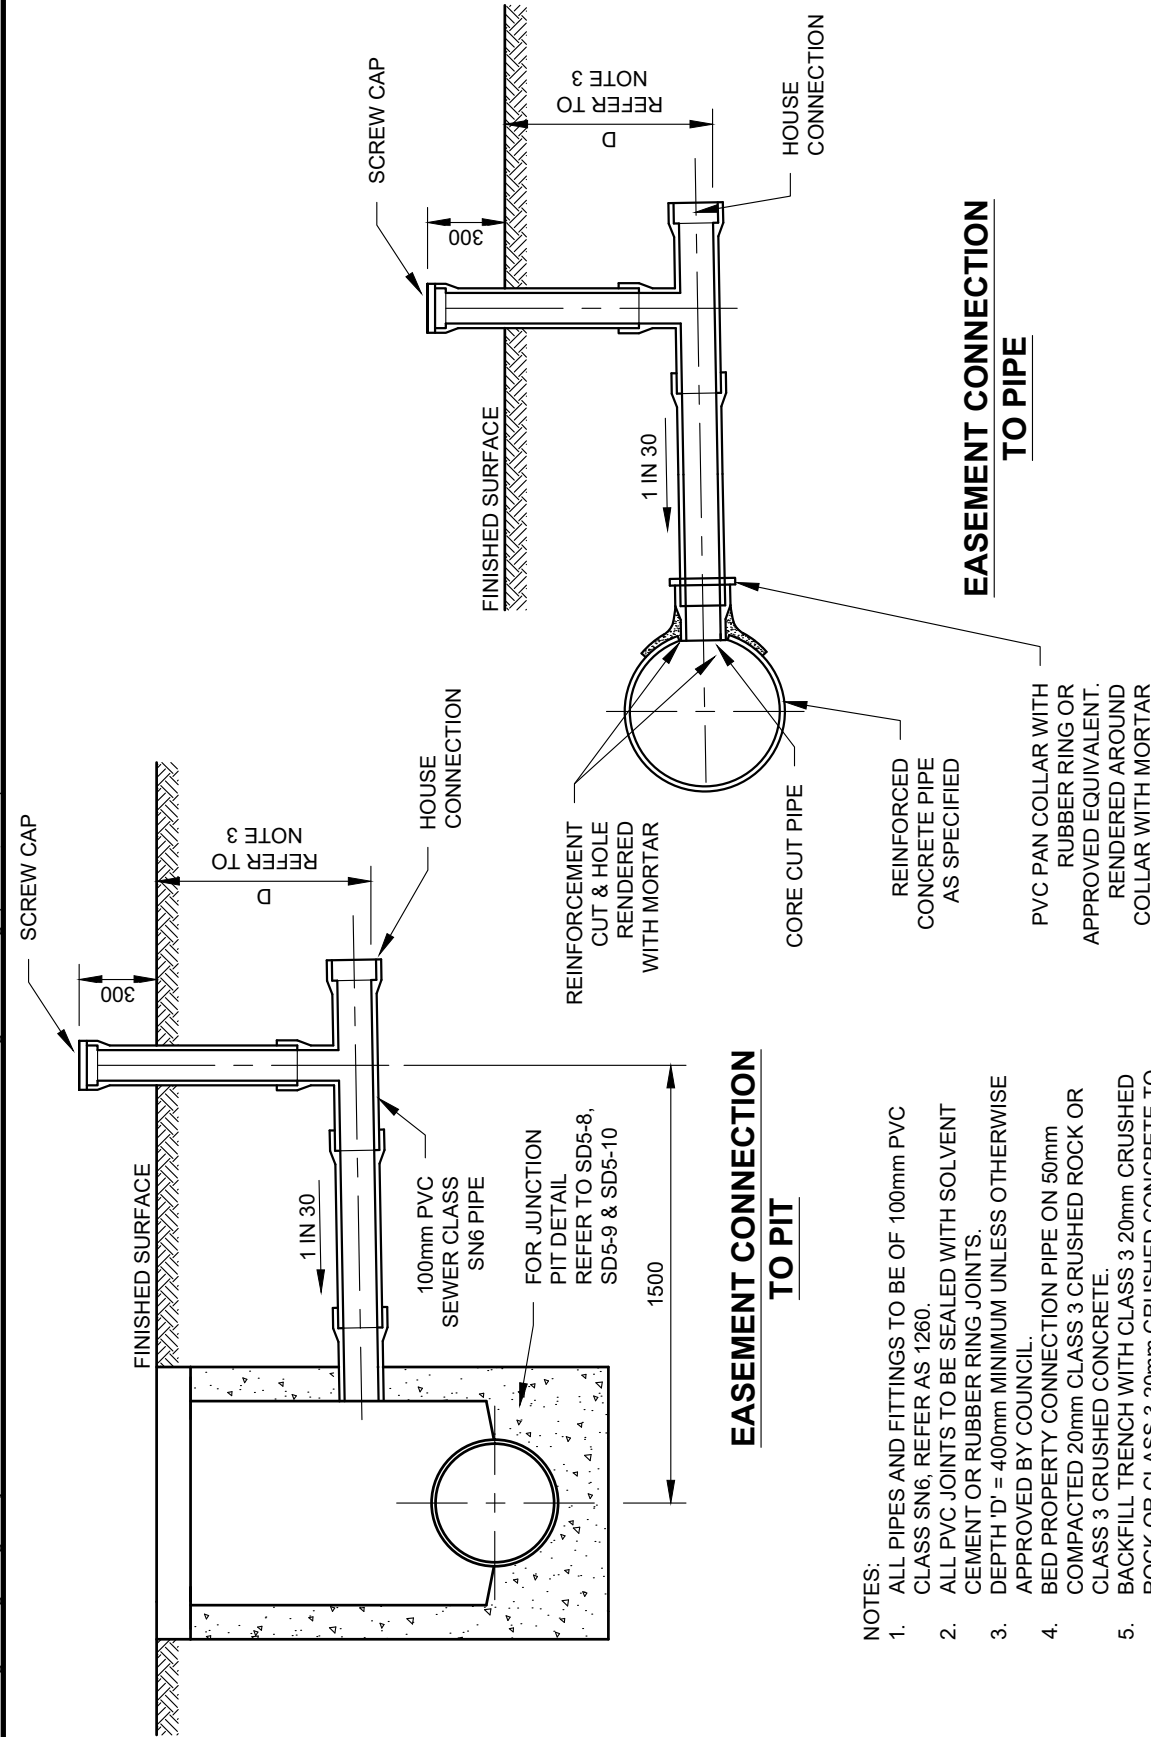

- NOTES:
1. ALL PIPES AND FITTINGS TO BE OF 100mm PVC CLASS SN6, REFER AS 1260.
 2. ALL PVC JOINTS TO BE SEALED WITH SOLVENT CEMENT OR RUBBER RING JOINTS.
 3. DEPTH 'D' = 400mm MINIMUM UNLESS OTHERWISE APPROVED BY COUNCIL.
 4. BED PROPERTY CONNECTION PIPE ON 50mm COMPACTED 20mm CLASS 3 CRUSHED ROCK OR CLASS 3 CRUSHED CONCRETE.
 5. BACKFILL TRENCH WITH CLASS 3 20mm CRUSHED ROCK OR CLASS 3 20mm CRUSHED CONCRETE TO 100mm ABOVE THE PROPERTY CONNECTION PIPE.
 6. TRENCH UNDER FOOTPATH TO BE BACKFILLED WITH COMPACTED 20mm CLASS 3 CRUSHED ROCK.
 7. IF THE HOLE IN THE PIT WALL FOR THE PIPE IS NOT AVAILABLE, A HOLE IS TO BE CORE DRILLED.

REV	AMENDMENTS	APPROVAL	DATE
B	MINOR DRAFTING MODIFICATIONS		14-05-07
C	UPDATED TO REFLECT CURRENT STANDARDS	M.BRIGANDI	21-05-24
D	MINOR DRAFTING MODIFICATIONS	M.BRIGANDI	27-03-25

EASEMENT PROPERTY INLET CONNECTION



45 PRINCES HIGHWAY
WERRIBEE, VIC 3030

TEL: 1300 023 411
wyndham.vic.gov.au

CAD FILE: SD6-3.DWG

DRAWN DATE: FEB 2024

REVISION: D

DRAWING NO.:

SD6-3

GENERAL NOTES:

- DRAWINGS ARE NOT TO SCALE.
- ALL MEASUREMENTS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
- FOR UP TO DATE DRAWINGS PLEASE CHECK WYNDHAM CITY COUNCIL WEBSITE.
- ALL STANDARD DRAWINGS TO BE USED IN CONJUNCTION WITH SD1-1 (STANDARD DRAWINGS CONDITIONS OF USE).